



GROUND FLOOR BEAM

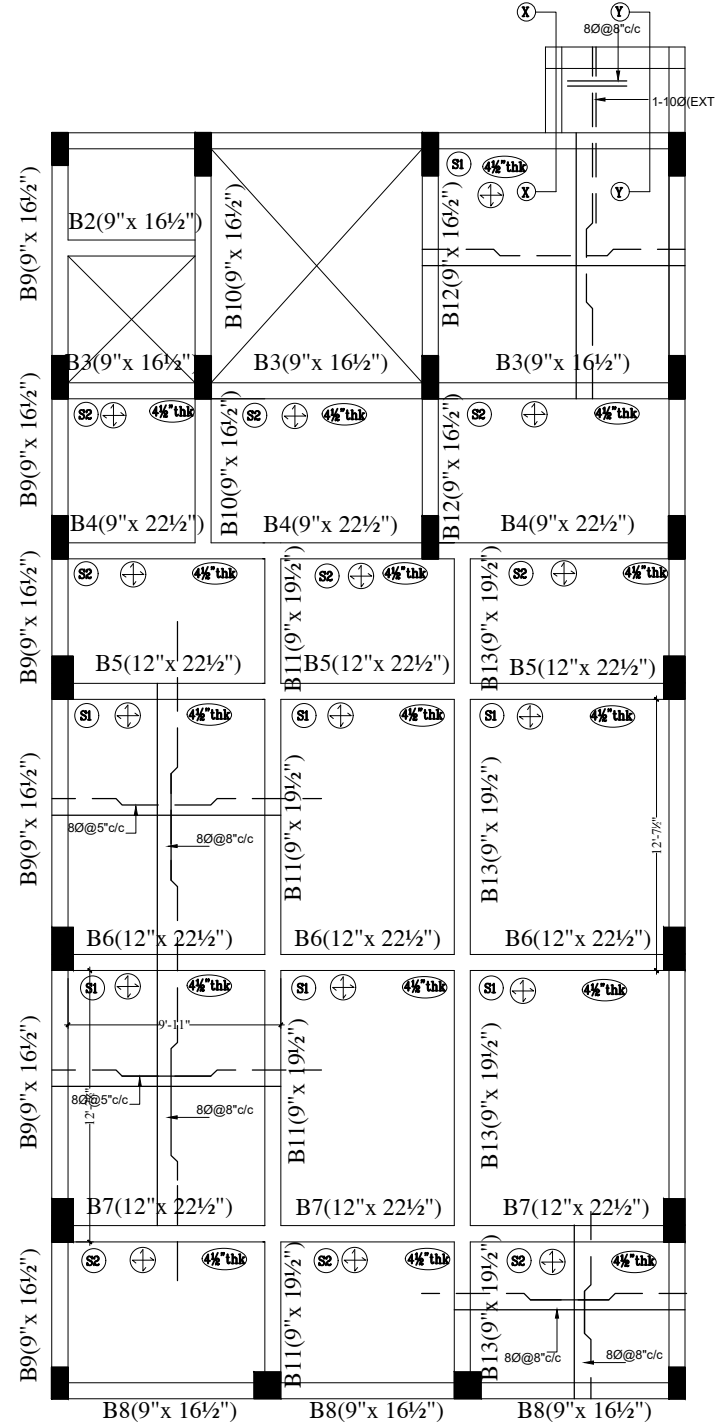

GROUND FLOOR BEAM

SCHEDULE OF SLABS				
SLAB MARK	THICKNESS	TYPE	REINFORCEMENT STEEL AT	
			SHORT SPAN	LONG SPAN
S1	4 1/2"	↕	8Ø @ 5" C/C	8Ø @ 8" C/C
S2	4 1/2"	↕	8Ø @ 8" C/C	8Ø @ 8" C/C

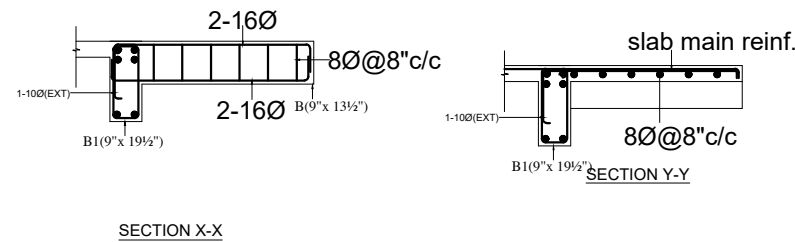

NOTE :

- USE M20 (1:1.5:3) GRADE CONCRETE FOR BEAMS & SLAB
- USE FE500 GRADE TOR STEEL.
- PROVIDE CLEAR COVER OF 1" FOR BEAMS & 3/4" FOR SLAB
- PROVIDE 1" CAMBER AT FREE END FOR CANTILEVER BEAMS & SLABS.
- IN SLAB EXTEND -VE STEEL UPTO 0.30L FROM FACE OF SUPPORT.
- DO NOT PROVIDE EXTRA REINFORCEMENT AT SIMPLY SUPPORTS.
- LAP LENGTH 48 D (D- IS THE DIA OF THE BAR) IN COMPRESSION.
- LAP LENGTH 52 D(D- IS THE DIA OF THE BAR) IN TENSION.
- ONLY FIGURED DIMENSIONS SHALL BE FOLLOWED.
- ALL THE DIMENSIONS ARE IN INCHES & FEET.
- DO NOT SCALE THE DRAWING.
- REFER ARCHITECT DRAWING FOR CENTER LINE DIMENSIONS.
- LAP LENGTH INCLUDING ANCHORAGE VALUE OF HOOKS FOR BARS IN FLEXURAL TENSION SHALL BE L_d OR 30ϕ WHICHEVER IS GREATER. THE STRAIGHT LENGTH OF THE LAP SHALL NOT BE LESS THAN 15ϕ OR $200mm$. WHEN BARS OF TWO DIFFERENT DIAMETERS ARE TO BE SPLICED, THE LAP LENGTH SHALL BE CALCULATED ON THE BASIS OF DIAMETER OF THE SMALLER BAR.
- LAP / DEVELOPMENT LENGTH FOR MAIN REINFORCEMENT BARS FOR DIFFERENT GRADES OF CONCRETE MIX SHALL BE AS FOLLOWS:

STEEL GRADE	M20	M25	M30	M35
Fe 415	47	d 41	d 38	d 34
Fe 500	57	d 49	d 46	d 40

 WHERE d IS THE DIAMETER OF THE BAR.

REVISED SLAB	
DESCRIPTION	DATE 25-05-18

Client	MODI PROPERTIES & INVESTMENTS PVT.LTD		
Project	CLUB HOUSE (SOV)		
STRUCTURAL CONSULTANT	KULKARNI CONSULTANT'S STRUCTURAL ENGINEERS, ARCHITECTS & PROJECT CONSULTANT'S # 216, KUBERA TOWER'S, NARAYAN GUJA-HYDERABAD. CONTACT NO'S:- 04023223891, 09246343724, 09246343720.		
DATE	05-12-2018	TITLE:	GROUND FLOOR SLAB DETAILS
DEALT BY	BASHA	DWG. NO.	KC/FH/SD/9
DESIGN BY	SANTOSH	REV. No.	0
CHECKED & APPROVED:	KULKARNI		