


(TANK size 5.50M LONG x 1.94M Dia)

INSTALLATION OF 15KL TANK IN EARTH PIT WITH STRIP RAFT FOUNDATION

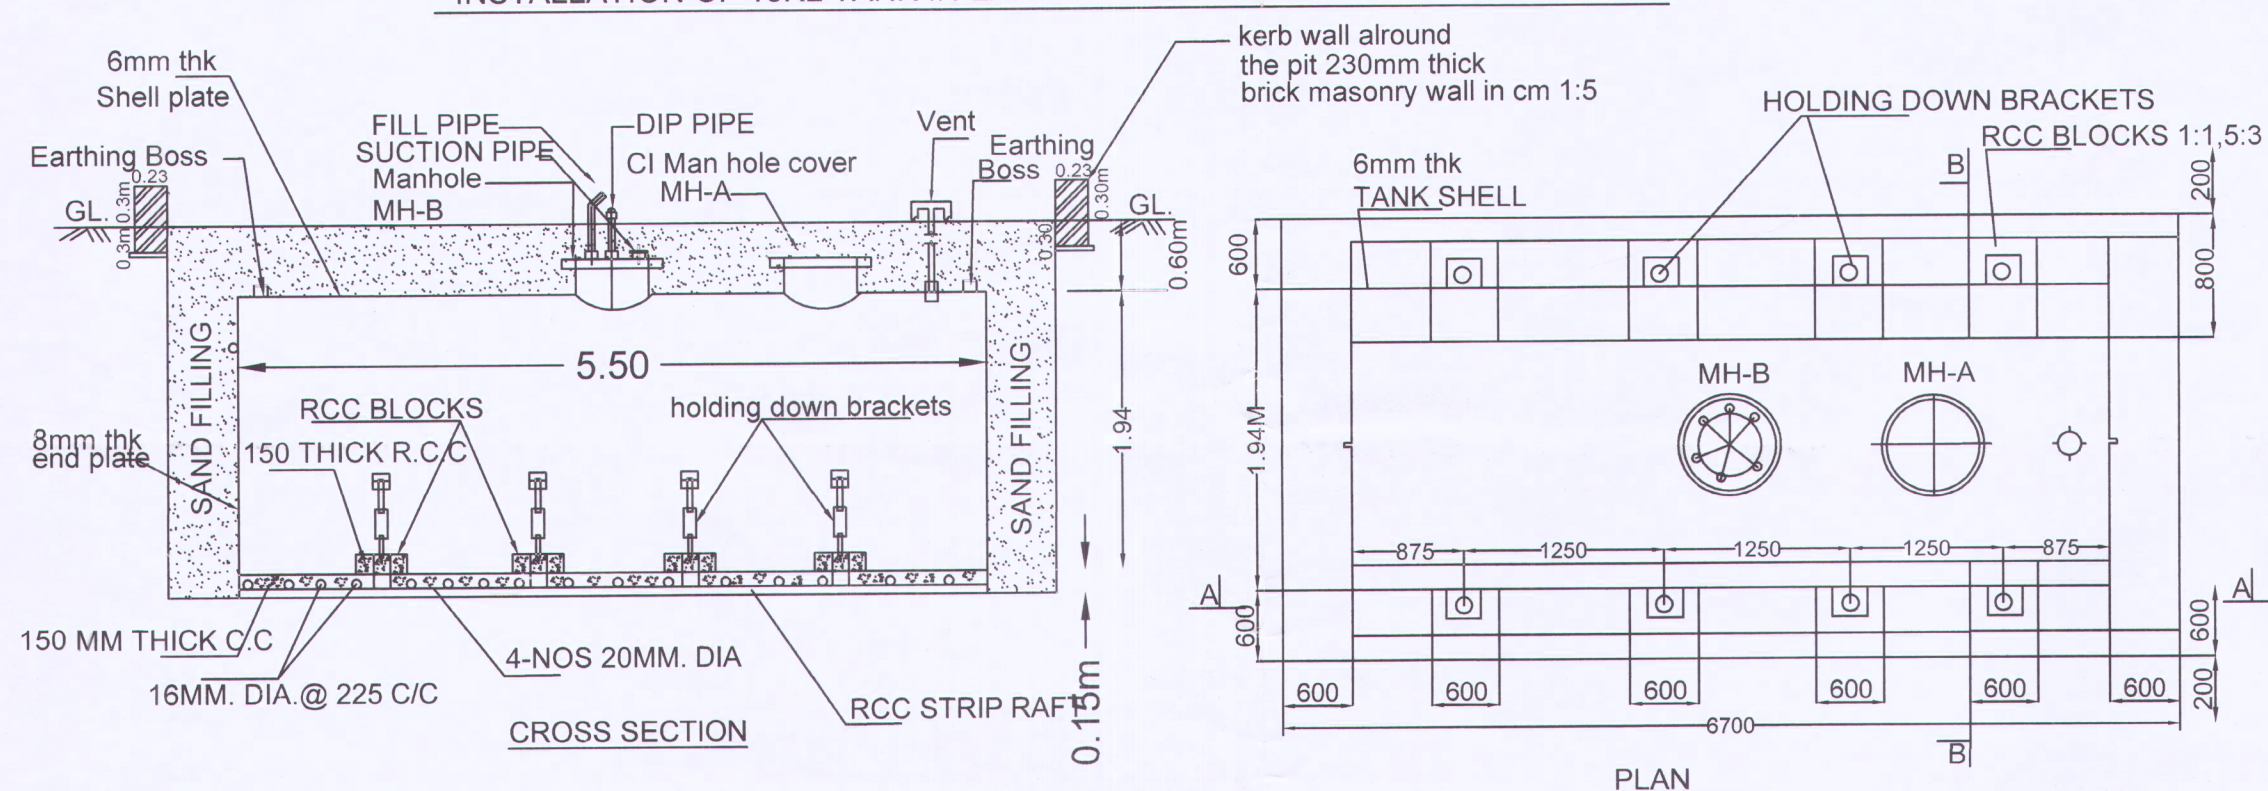





NOTES:

1. TANKS SHALL BE PAINTED BY ANTI CORROSIVE PAINTS
2. E.P: TANKS SHALL BE PROPERLY EARTHED
3. ALL ELECTRICAL APPARATUS SHALL BE OF FLAME PROOF AS IEC:- 60079
4. UNDER GROUND PIPE LINES PASS THROUGH SLEEVES & OVER HEAD PIPE LINE SHALL BE WELL SUPPORTED
5. SFB: SAND FILLED BUCKETS EACH CAP: 10 Kgs.
F.E: FIRE EXTINGUISHERS DRY CHEMICAL POWDER TYPE EACH CAP.: 9 Kgs.

6. INSTRUCTION BOARDS:
"NO SMOKING PLEASE"
"EXPLOSIVE LICENCE No....."
7. EVP: EXTENDED VENT POINTS
EFP: EXTENDED FILL POINTS
8. TANKS WILL BE FABRICATED AS PER IS: 10987
9. ALL GATE OPENING OUTSIDE

1. PROPOSAL SHOWN IN RED.
2. DISMANTLED SHOWN IN YELLOW
3. APPROVED BUT NOT CONSTRUCTED SHOWN IN GREEN

1x15KL UNDER GROUND MILD STEEL TANK IN EARTH PIT FOR STORAGE OF HSD (CLASS - 'B') OF SIZE 1.94M DIA.5.50M LONG (TANK FABRICATED AS PER IS 10987 OF 1992)
PESO APPROVAL NO REF NO: P-6(3)51, DT: 23.01.2007.

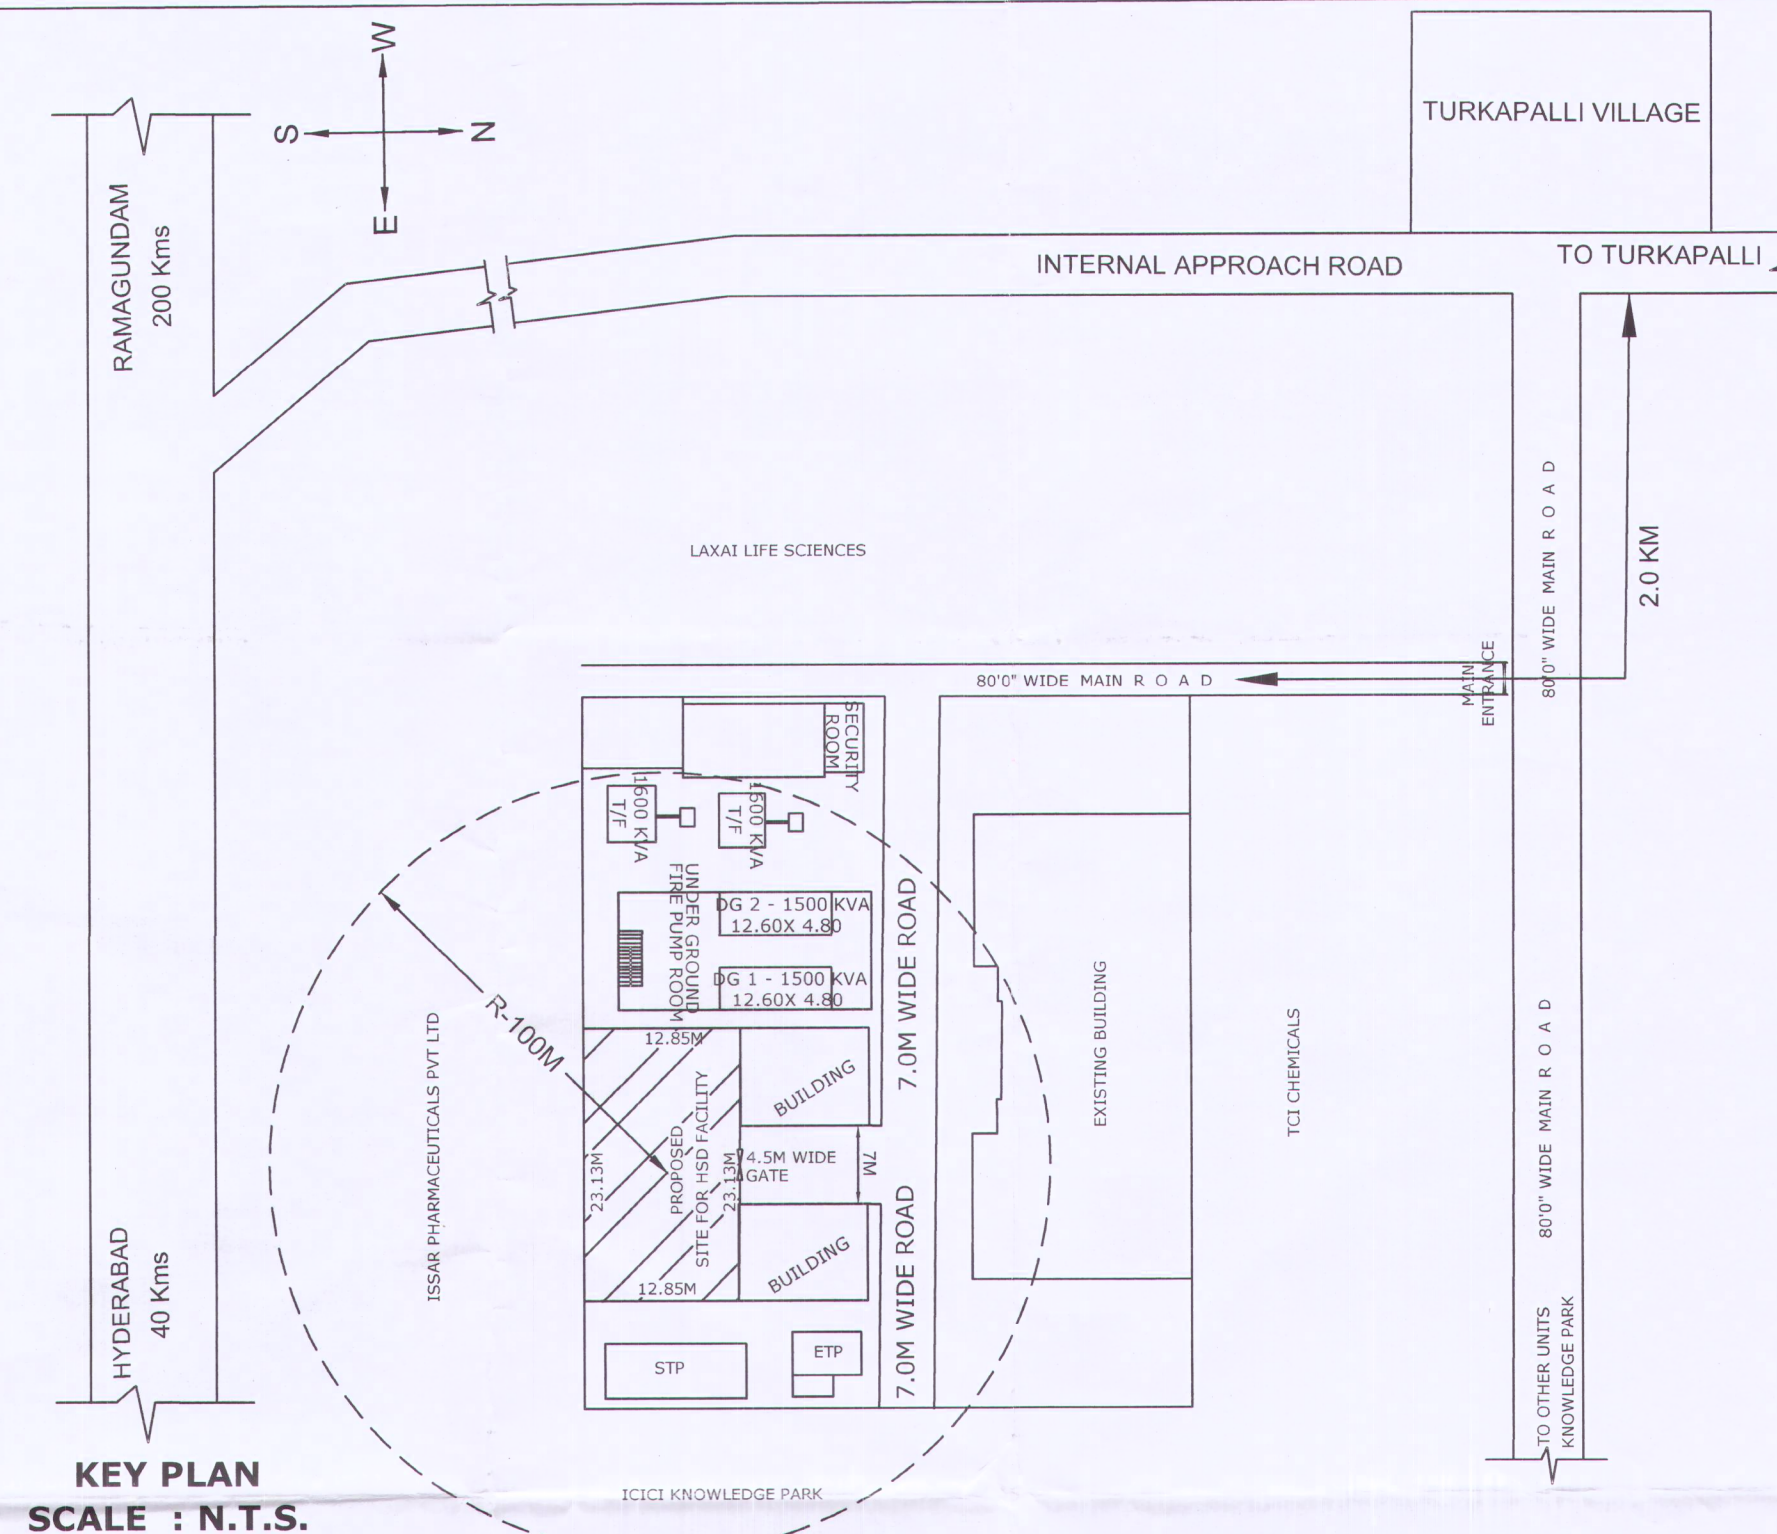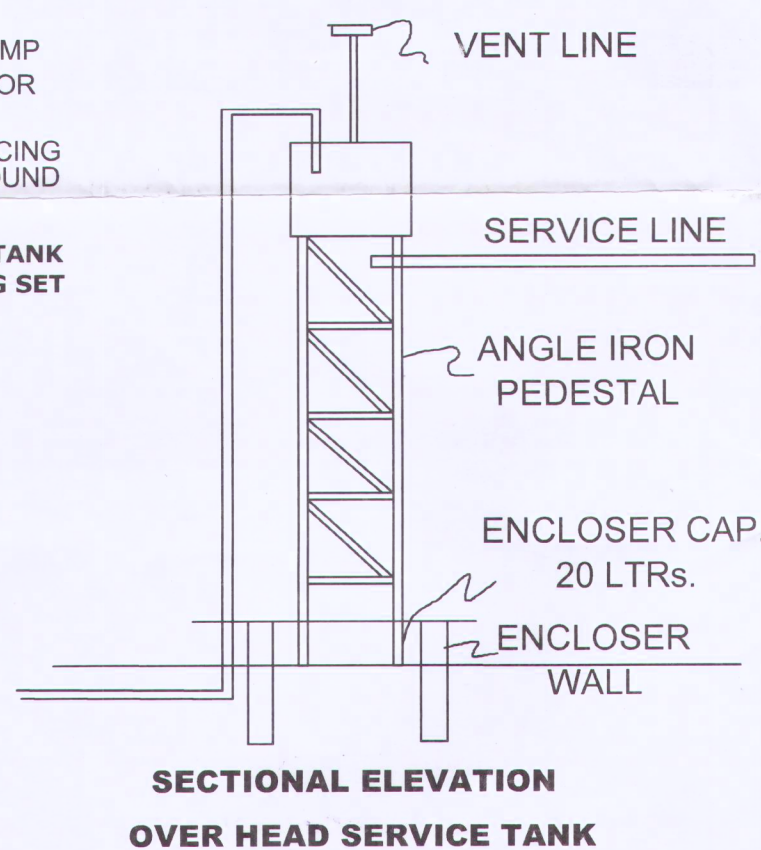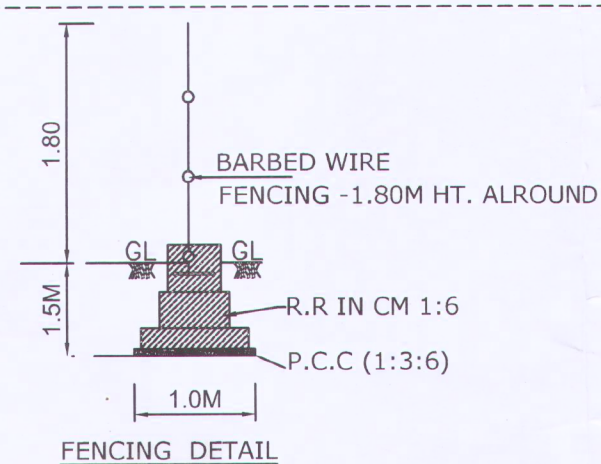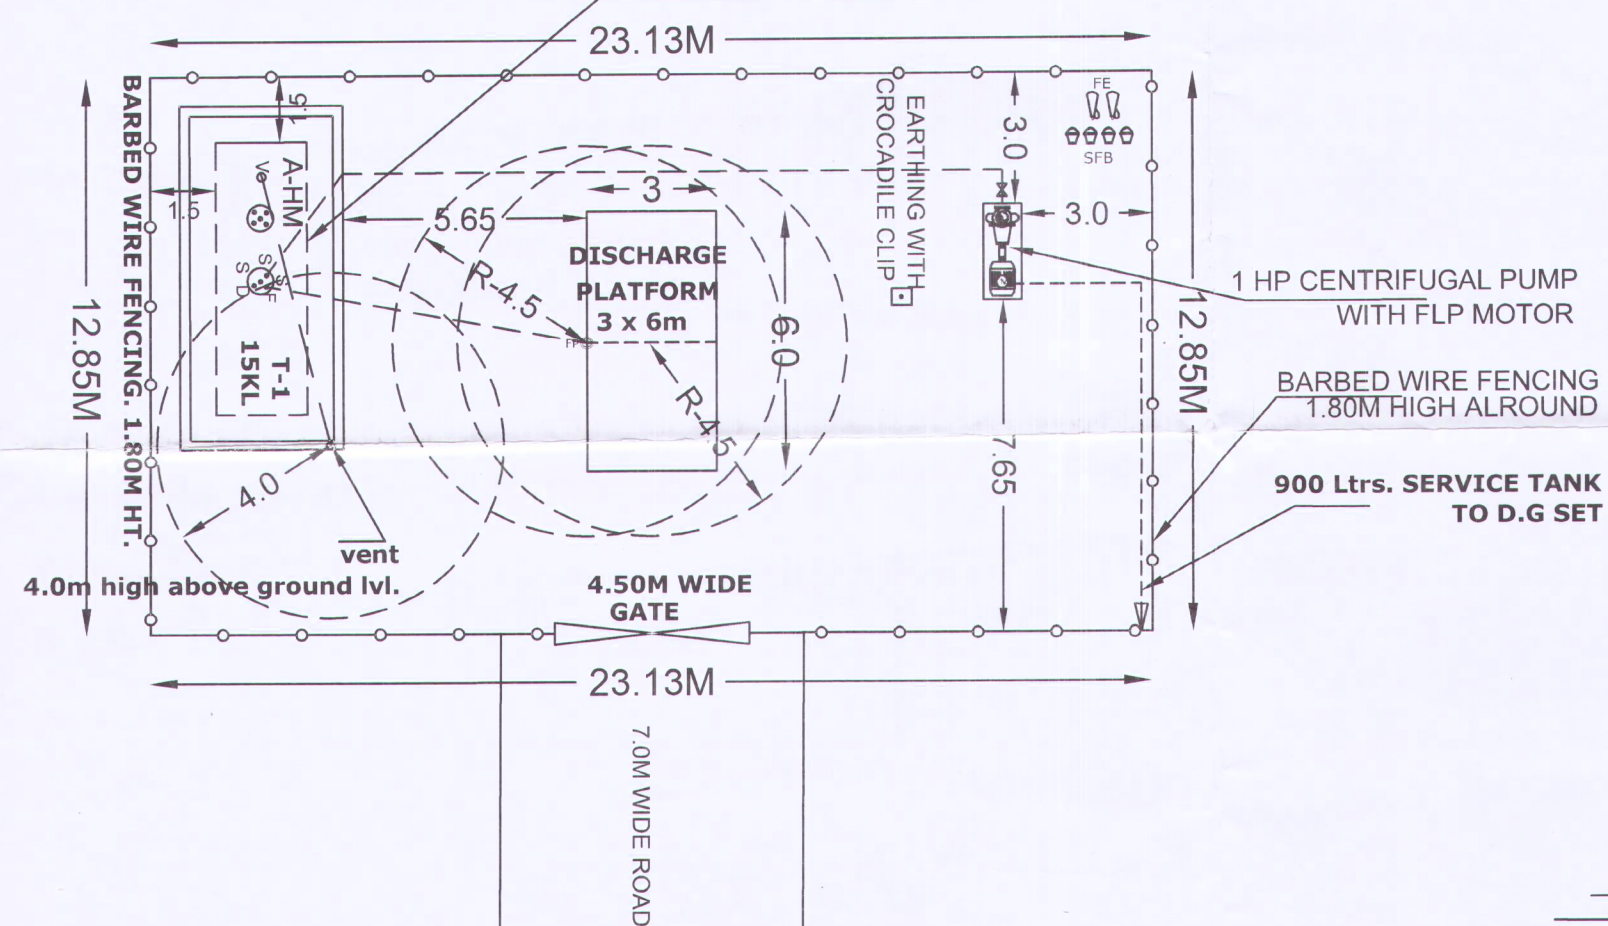

KEY PLAN
SCALE : N.T.S.

SURVEY.NO	--	234 & 235 PLOT NO: 1A
VILLAGE	--	TURKAPALLI
MANDAL	--	SHAMIRPET
DISTRICT	--	MEDCHAL MALKAJGIRI
NEAREST RAILWAY STATION	--	SECUNDERABAD
NEAREST POLICE STATION	--	SHAMIRPET
NEAREST FIRE STATION	--	ICICI KNOWLEDGE PARK
PIN CODE	--	500078

TANK DETAILS					
CAP.	PRODUCT	PUMP	TANK SIZE	PLATE THICKNESS END	SHELL
1x15KL	HSD	FLP MOTOR 1 HP-1 Nos	1.94Mx5.50M	8MM	6MM

SITE AREA : 297.22 Sqm

No. 53/TH IACP/BNR-T/Cyberabad/2022-23 Dt: 03/12/22



INDIANOIL CORPORATION LTD
(SOUTHERN REGION)
MARKETING DIVISION
DIVISIONAL OFFICE, SECUNDERABAD

PLAN SHOWING THE PRO.PETROLEUM CLASS "B" IN PLOT NO: 1A
SURVEY NO: 234 & 235 M/s. G.V.DISCOVERY CENTERS PRIVATE LIMITED
TURKAPALLI VILLAGE, SHAMIRPET MANDAL, MEDCHAL MALKAJGIRI DT
TELANGANA STATE.

PREPARED BY. S.JAYADEV VIJAYAWADA	CHECKED BY.	APPROVED BY 	DATE : 04.11.2022 DRG No : NEW CP/CP/ GVDCL /22 SCALE : 1:150
---	-------------	-----------------	---